



Research Article

Technical and economic evaluation of a standalone and on grid hybrid renewable energy: A case study at Eskişehir Technical University

Hussein Kerow ADAN^{ORCID}, Ümmühan BAŞARAN FİLİK*^{ORCID}

Department of Electrical and Electronics Engineering, Eskişehir Technical University, Eskişehir, Turkey

ARTICLE INFO

Article history

Received: 22 May 2020

Accepted: 25 January 2021

Key words:

Cost of energy, hybrid optimization model, sensitivity analysis, standalone and grid connected hybrid energy system, net present cost, technical and economic feasibility.

ABSTRACT

Because of high-energy demand, population increase and exhaustion of fossil fuels, renewable energy is being utilized around the world especially for hybrid systems. The hybrid system should be optimally sized hence the aim of the study is to determine the technical and economic evaluation of a standalone and on grid hybrid system to supply power to the Department of Electrical and Electronics Engineering in Eskişehir Technical University. Hybrid optimization model for multiple energy resources (HOMER) program is used to achieve the optimal configuration of the standalone and on grid hybrid system and these systems are compared to each other to see the most economical one according to the net present cost (NPC) and cost of energy (COE). The result revealed that the most optimal configuration of the two systems is PV/Grid hybrid system with 198kW PV panel and the grid. It has NPC and COE of \$1.68M and 0.176\$/kWh but is not environmentally friendly as a standalone system due to low renewable fraction (RF). Overall, by using hybrid renewable energy systems (HES), the study is trying to solve the problem of reliability, cost and environmental concerns of the conventional energy sources.

Cite this article as: Adan HK, Başaran Filik Ü. Technical and economic evaluation of a standalone and on grid hybrid renewable energy: A case study at Eskişehir Technical University. Sigma J Eng Nat Sci 2021;39(2)184–194.

INTRODUCTION

In 21st century, energy demand is high due to population increase and urbanization. The main challenge is to meet the rising energy demand without interfering with the resources. In the last decade, temperature has increased leading to debates on global warming between countries. High-energy demand is met through fossil fuels. This conventional source releases greenhouse gases, which is

harmful to the atmosphere [1]. In order to meet the high demand of energy, the share of renewable energy sources (REs) needs to be increased. Therefore, is considered as a good substitute to conventional sources because they are clean, eco-friendly and reduce pollution. So, it promotes the sustainability of a nation [2–4]. Nevertheless, the major challenge of REs is that they are intermittent meaning they highly depend on the atmospheric condition leading to fluctuation of energy production. They also have high

*Corresponding author.

*E-mail address: ubasaran@eskisehir.edu.tr

This paper was recommended for publication in revised form by Section Editor Necmiye Özlem Ünverdi.



initial capital cost. To avoid this problem, the REs should be combined with the conventional energy sources by utilizing the strength of one energy source to balance the weakness of the other making it a hybrid energy system (HES).

To avoid this problem, the REs should be combined with the conventional energy sources by utilizing the strength of one energy source to balance the weakness of the other making it a hybrid energy system (HES). If a higher capacity renewable energy resource is used, the total amount of carbon dioxide is reduced [5].

The most important advantages of HES are reliability, price reduction, efficiency improvement and less air pollutant as compared to stand alone renewable systems [6, 7]. Recently, the use of hybrid renewable energy systems is becoming popular as a substitute to fossil fuel usage [5]. The challenge of HES is to come up with the optimal size and configuration of the system to meet the load demand at lowest cost and achieve an economically attractive system [7, 8]. Since there are few studies comparing techno-economic feasibility analysis of a standalone and grid connected hybrid system. The paper focuses on the technical and economic evaluation of HES with and without the utility grid using HOMER software to find the optimal configuration and cost-effective system as well as environmentally friendly to supply power to an Electrical and Electronics Department in Eskişehir Technical University.

Several studies have been realized to examine technical and economic evaluation of HESs. Some of them are given below:

In [1] they conducted a technical and economic evaluation of PV/diesel genset/on grid hybrid system using HOMER program to supply power to an institution of Engineering in New Delhi/India. The result showed that, PV/ Grid configuration was the most economical one with least COE of 0.12 \$/kWh. This is the same as the cost of grid electricity but with time grid price is expected to increase, hence making PV/Grid connected system more economical.

In [5] the feasibility of adding a renewable source to a village in Iran that was powered by diesel generator and connected to the grid using HOMER software was examined. Firstly, the paper examines how economical it would be to supply the village with the diesel genset and add renewable resources. On the other hand, they explored how the renewable energy resources can be combined with the utility grid to achieve an inexpensive and eco-friendly hybrid system. The results showed that combination of renewable energy to the diesel only system before and after the arrival of the grid could have lowered the expenses and reduced emissions.

In [6] studied a technical and economic study of different hybrid renewable energy using HOMER pro program to achieve an optimal configuration to supply power to a remote area in Sri Lanka. PV/WT/DG/battery having 20 kW solar panel, 40 kW wind turbine, 20 kW diesel genset and 40 battery banks was the most economical hybrid con-

figuration and supplied power with 0.36 \$/kWh COE. The energy price was more expensive than the grid price in Sri Lanka but due to lack of utility grid in the study area, the hybrid system would improve the rural lifestyle and reduce greenhouse gas emissions.

In [9], they performed techno-economic study of a hybrid renewable energy system for remote area in Sinai, Egypt. HOMER software was used to get an optimal configuration based on NPC and COE. They found that a HES, which consists of a 10kW PV panel, 7.5kW wind turbine, 2.8kW diesel generator and 20 batteries (360 Ah), supplied power to the load demands. The NPC and COE of the system was \$113,256 and 0.179\$/kWh respectively, hence, PV/Wind/Diesel/Battery system is considered more economical and reduced the CO₂ emissions.

In [10], it talks about how technical and economic evaluation of PV/Wind/battery/grid hybrid system was performed using HOMER software to electrify an institution of Research and Technology in Tunisia. The results presented NPC and COE of \$44,705 and 0.224\$/kWh and a maximum renewable fraction (RF) of 78%, but after considering sensitivity analysis based on the speed of wind, global solar insolation, cost of grid power and sellback cost. PV/grid hybrid system turned out to be the most economical configuration with \$27,986 NPC and 0.140 \$/kWh COE. The technical and economic study of standalone PV/diesel genset/battery hybrid system was analyzed to provide energy to a remote area in Eastern part of Iran [11]. They used the HOMER program for simulation purposes. The system's NPC, RF and air pollutant were used as a criterion to determine the most feasible system. The program indicated that a standalone hybrid system with 15 kW PV panel, 20kW diesel genset and 20kW inverter was the cost-effective system with NPC, COE and RF of \$309,034, 0.464 \$/kWh and RF of 30%. But adding 10 batteries to the system reduces NPC to \$286,315 and COE to 0.430 \$/kWh but increases RF to 35% making it more feasible. They finally concluded that PV/diesel genset/battery standalone configuration is not only economical but also a perfect candidate to provide power to rural areas in Iran.

A related approach of technical and economic study of two different hybrid renewable energy systems using the HOMER program was done by [12]. The results indicated that HES that used battery as energy storage was cost effective with NPC of \$581,916 and COE of 0.359 \$/kWh while the system that used hydrogen as energy storage was eco-friendly but not cost effective with NPC of \$603,856 and COE of 0.373 \$/kWh. The system that used hydrogen was the best system from the environmental point of view due to lack of emissions.

Mondal et al. [13] conducted a HOMER simulation to determine the potential of HES to provide power to a remote village in Ethiopia with lowest cost of energy (COE) and the system is compared with a diesel only system. The

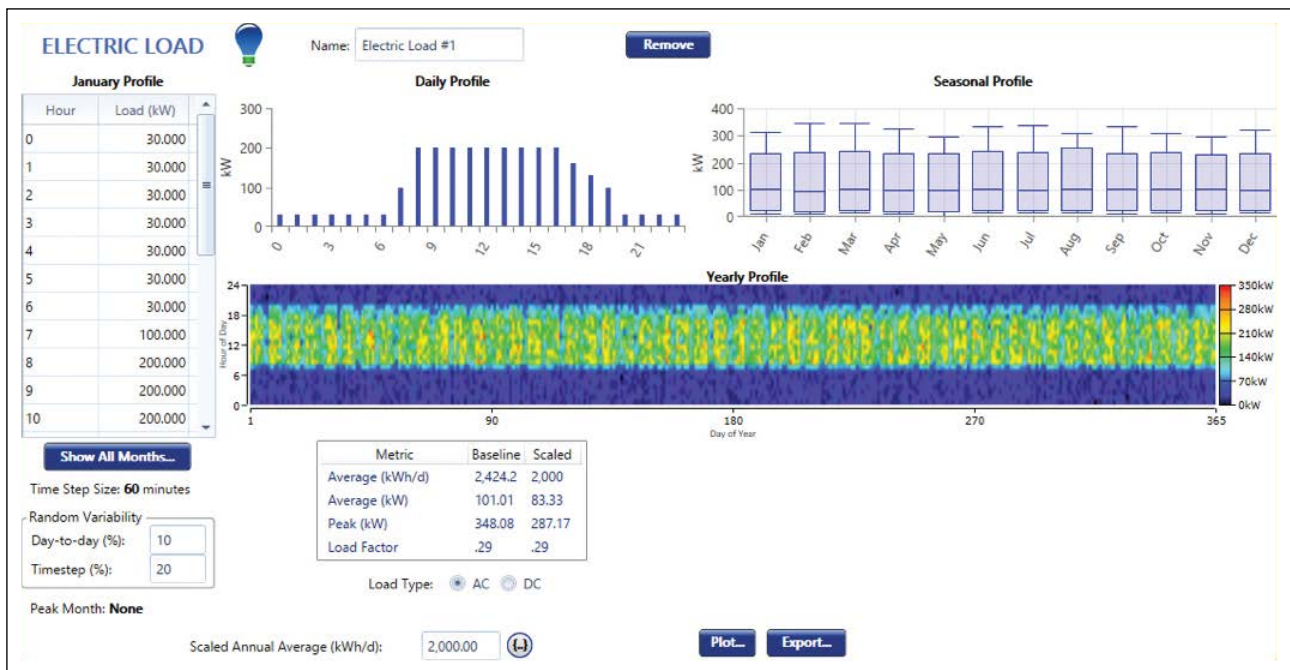


Figure 1. Load profile for the study area.

researchers learnt that PV/WT/DG/battery configuration had the least NPC and COE of \$82,734 and 0.207 \$/kWh respectively. The system cuts 37.3 tons of CO₂ when compared to diesel genset system, hence renewable HES is considered the best system especially in remote areas.

The aim of the study is to examine the technical and economic evaluation of various HES with or without the utility grid using HOMER software to find the most economical and eco-friendly hybrid system. This way the study promotes the use of hybrid renewable energy for government, commercial and residential buildings in Turkey. The sections of this work are organized as follows: In the current section describes the introduction and literature review, section 2 describes the methodology, Section 3 covers the results and discussion, and conclusion is presented in section 4.

METHODOLOGY

Modelling of renewable energy systems are extremely dependent on meteorological data and load profile, so the relying of the system can be increased by using more renewable energy sources. To have a continuity of power, it is always good to rely on two or more energy sources. This study considers several different configurations of hybrid renewable systems and compares them using the HOMER pro program for simulation, optimization and sensitivity analysis. The software was developed by the National Renewable Energy Laboratory (NREL) of USA. It simulates a standalone and an on-grid energy system based on input parameters such as load profile, renewable resources, and the component's technical and economic specifications. The

program runs the simulations of all possible combinations and gives the results according to the most cost-effective ones that can meet the load demand by arranging them in terms of their NPC in ascending order. The system with the lowest NPC is the optimal hybrid configuration [8, 14, 15].

Load Profile

The Department of Electrical and Electronics Engineering in Eskişehir Technical University is used as a case study. The average electrical load for the department is taken as 2MWh/day. Grid-connected and a standalone HES is simulated using the HOMER. Load profile is given in Figure 1.

Available Renewable Energy Resources

Solar Energy: The solar irradiance was obtained from NASA surface meteorology. Figure 2 shows the monthly solar radiation and clearness index values. The highest solar radiation is experienced in the month of July and the lowest in the month of December. From the Figure 2, the average daily solar radiation in all of the year is 4.26 kWh/m²/day.

Wind Energy: The related wind energy data is download from NASA surface meteorology. The Figure 3 shows that the highest wind speed is experienced in month of February and lowest in May. The figure also shows that the average wind speed at 50 m is 4.76 m/s. In winter the wind speed is high while in summer it is low which is the opposite of the solar insolation, this means that PV and Wind energy complement each other.

Components Considered for the Standalone and On Grid HES in HOMER Software

The two Figures 4 and 5 show a list of components

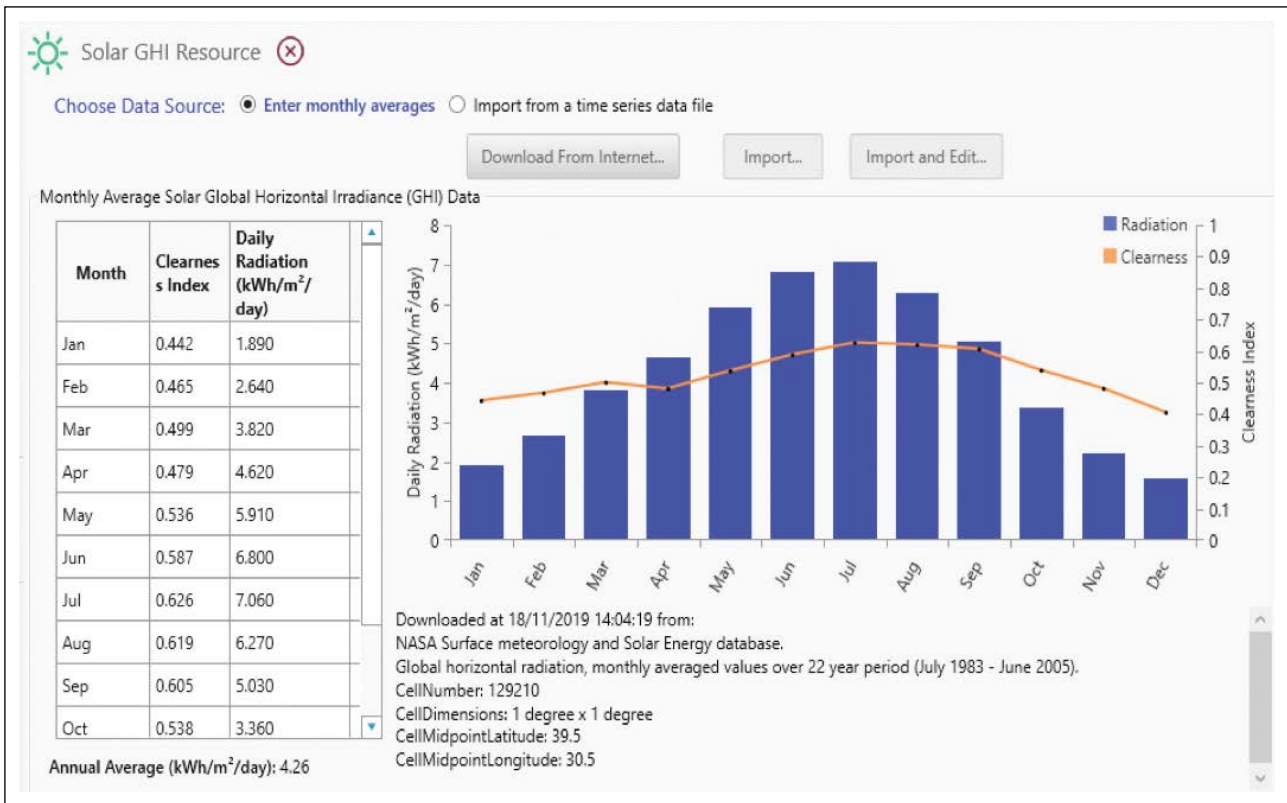


Figure 2. The monthly solar radiation and clearness index values.



Figure 3. Average monthly wind speed for Eskışehir region.

considered in the simulation of the HOMER program to determine the optimum HES for our case study. This way, the best-suited combination to serve the department’s load demand can be obtained.

Table 4. Cost data for diesel genset

Diesel genset	
Size kW	1
Capital cost (\$)	500
Replacement cost (\$)	500
O&M cost (\$/hr)	0.03
Fuel price (\$/L)	1.13
Life time (operating hours)	15000
Minimum load ratio (%)	25

Table 5. Techno-economic specifications of the selected converter

Converter	
Size (kW)	1
Capital cost (\$)	300
Replacement cost (\$)	300
O&M cost (\$/year)	0
Life time (years)	15
Efficiency (%)	95

Table 6. Optimization results for different standalone HES configuration

PV (kW)	WT (kW)	DG (kW)	Battery (no)	DS	NPC (\$)	COE (\$/kWh)	RF (%)
555	0	320	1.546	LFS	4.28 M	0.454	76.7
559	1	320	1.521	LFS	4.29 M	0.455	76.8
0	0	320	0	LFS	6.82 M	0.722	0
1.769	0	0	8.777	LFS	10.6 M	1.12	100

Dispatch strategy (DS): Aside from selecting different components, HOMER makes numerous decisions concerning the working together of components and if the power be sent to the grid or purchased from the grid, whether batteries be charged or discharged and when the generator should operate all these decisions take place for every hour of the day.

HOMER has two dispatch strategies. The load following strategy (LFS) and cycle charging strategy (CCS). LFS is a DS where diesel generator generates the required power when operating and the batteries are charged by the renewables. While CCS is a dispatch where diesel generator operates at a maximum capacity and the excess energy is used to charge the batteries. Therefore, for our proposed HES, LFS is adopted where the batteries will be charged by the renewables to minimize emissions and reduce fuel price [16, 18].

Technical and economic evaluation criteria: HOMER program uses technical and economic specifications and input parameters to come up with the optimal hybrid configuration. The optimal configuration is arranged according to Net Present Cost (NPC) and COE.

NPC: The major technical and economic evaluation criterion of the HOMER program is NPC. It is defined as the cost of installing and operating a hybrid system during its lifespan. It consists of all the profits and costs in a Project's lifespan, with future cash flows discounted to the present value [8, 16]. The formula for NPC is presented in the equation below.

$$NPC = \frac{TAC}{CRF(i, N)} \quad (1)$$

where TAC is the annualized cost of the hybrid system and CRF (i, N) is the capital recovery factor (CRF), i is ac-

tual interest rate and N is the project lifespan [7]. Formula for CRF is presented in the equation below:

$$CRF(i, N) = \frac{i(1+i)^N}{(1+i)^N - 1} \quad (2)$$

Levelized COE: It is an average cost per kWh of the electricity produced by hybrid renewable energy systems. It is also a ratio of the annualized system cost by the total electricity generated [16]:

$$LCOE = \frac{TAC}{E} \quad (3)$$

where E is the total electrical energy produced (kWh).

RESULTS AND DISCUSSION

Simulation results from HOMER software are presented and discussed in this section. The program executes simulations to come up with the most cost-effective hybrid system in terms of NPC and COE. The optimization results of both the standalone and the grid connected HES are analyzed and compared. HOMER ranks the optimal systems according to NPC and COE in ascending order, the most economical system is shown at the top and its able to satisfy the load demand with the lowest NPC.

Standalone Hybrid System

The optimization configuration of a standalone hybrid renewable energy system consisting of optimal systems, DS, NPC, COE and RF is given in Table 6. The optimal system is capable of satisfying the load demand of study location in Eskişehir Technical University.

As can be seen from the optimization results, PV/DG/Battery is the most cost-effective system with 555 kW solar

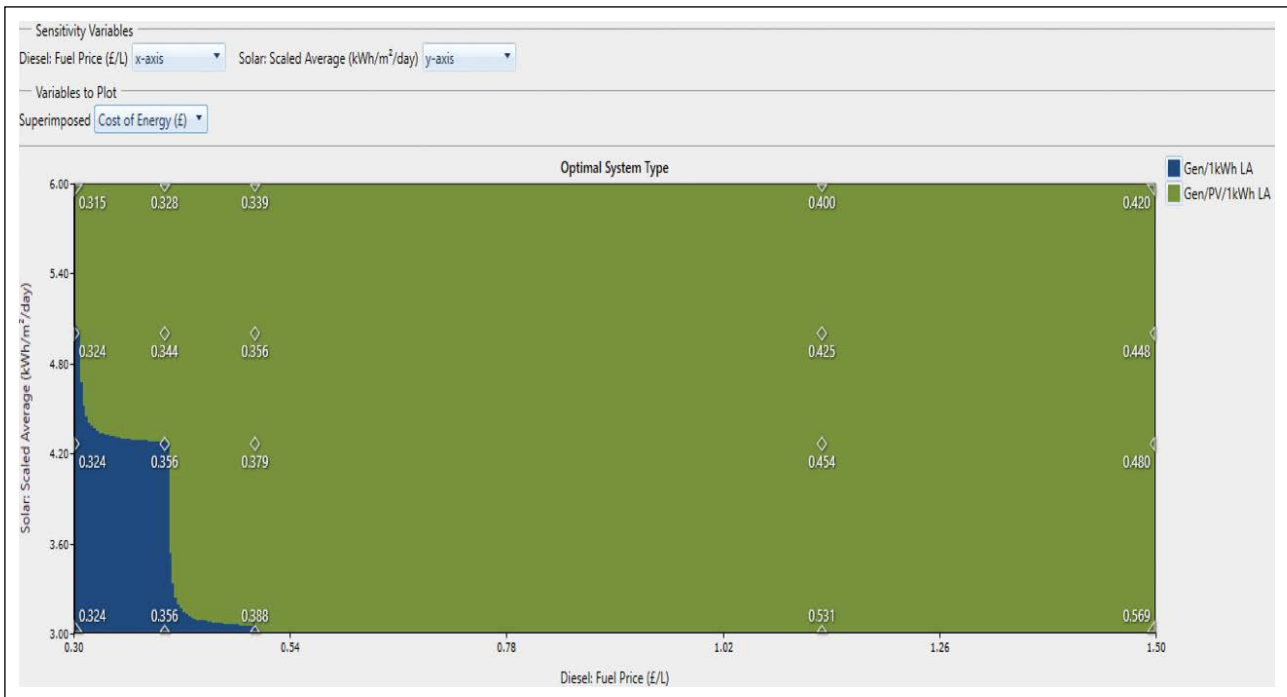


Figure 7. Sensitivity analysis on COE.

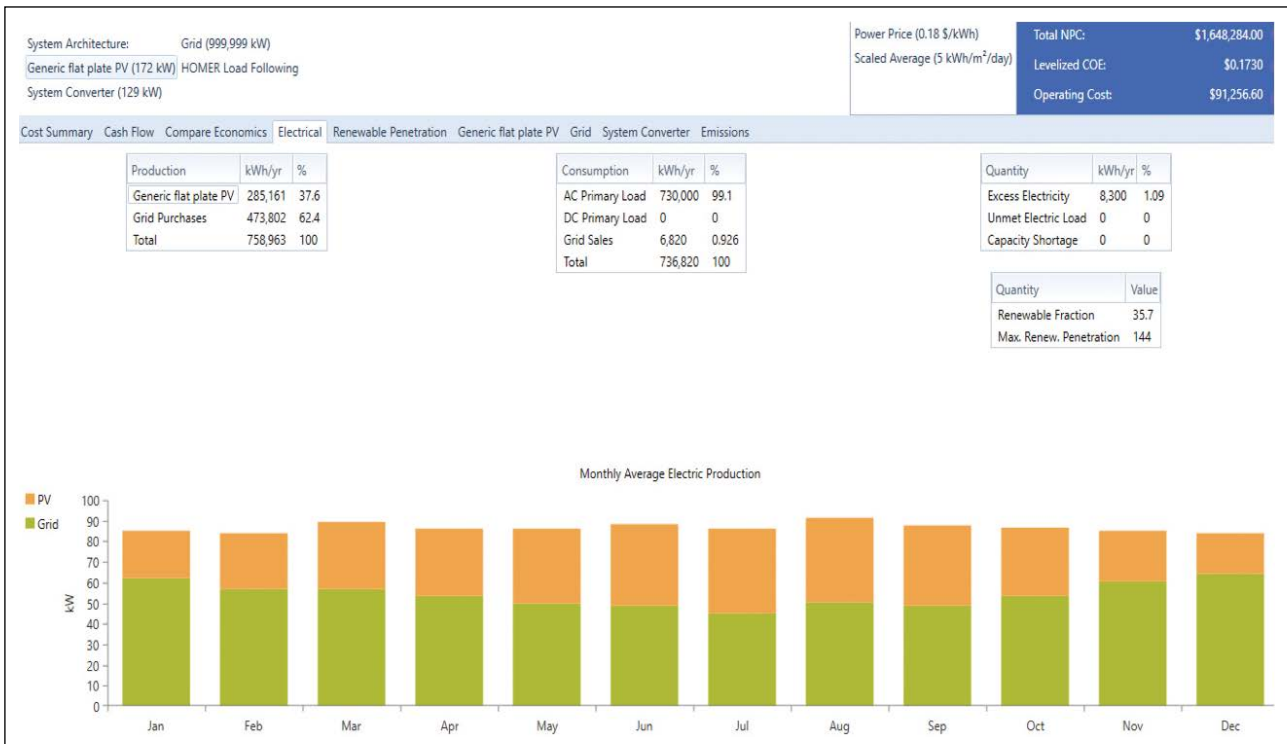


Figure 8. Average monthly electricity generation from PV/On grid hybrid system.

solar energy. Figure 7 shows sensitivity analysis on COE for different solar irradiation and price of diesel with 4.76 m/s speed of wind.

The Figure 7 illustrates that PV/DG/battery hybrid system is the most favorable system type for most parts of sen-

sitivity variables excluding the blue area. Because of this, PV/DG/battery hybrid combination is the cost-effective configuration. The DG/Battery becomes the optimal system type for diesel price less than 0.5L and solar insolation less than 4.20 kWh/m²/day. As can be seen from Figure 7,

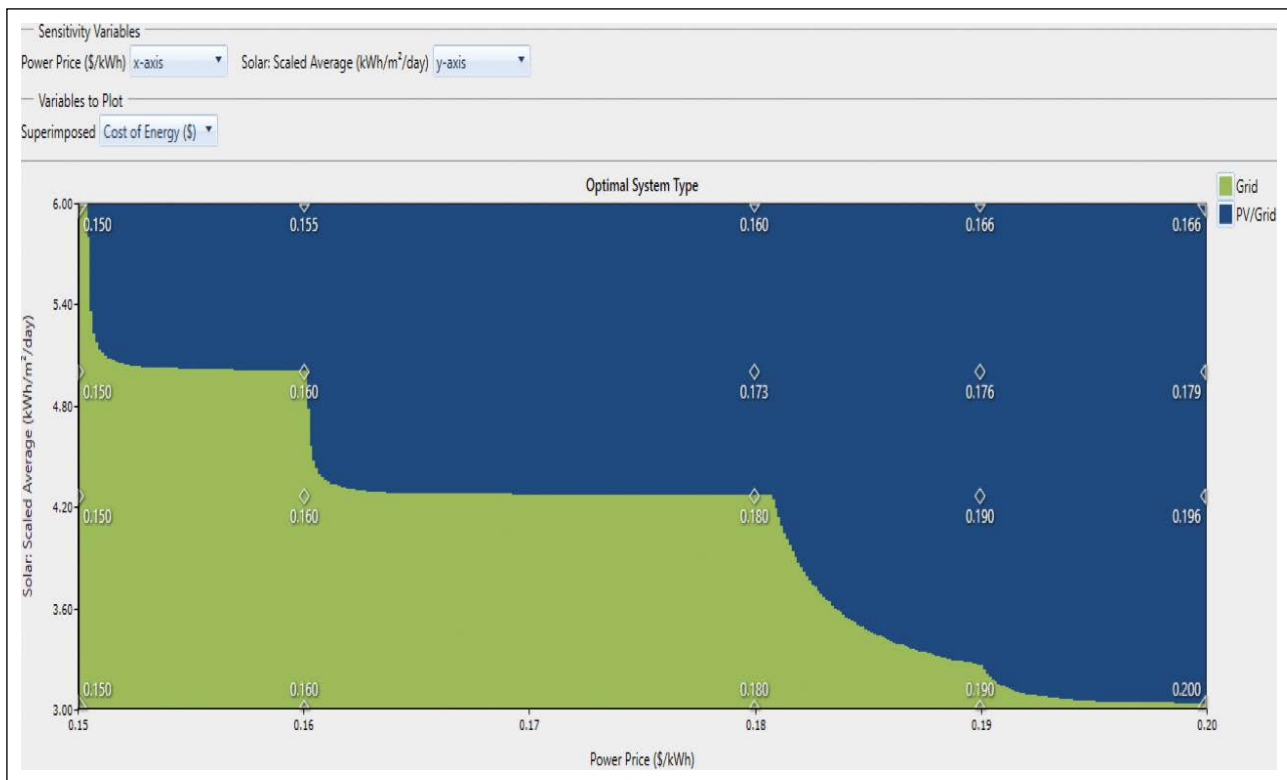


Figure 9. Sensitivity analysis on COE.

when the solar insolation rises, the COE declines. This is due to rise in the renewable percentage since more energy comes from renewables, the diesel generator will provide less power hence less fuel. The figure also shows that as the diesel price increases, the COE also increases. Changes in the COE for the variations in solar radiation within the range of 3.0–6.0 kWh/m²/day is about 0.015 \$/kWh which is negligible but for the variations in diesel price within the range of 0.3–1.5 \$/L is 0.217 \$/kWh. This means that diesel price has more effect on the COE than the solar radiation. Therefore, the most optimal system occurs at high solar radiation and low diesel price. Table 7 shows the optimization results of a grid connected hybrid system.

Grid connected hybrid energy system: The optimization results for different grid connected HES configuration is presented in Table 7.

The most cost-effective system as can be seen from the table is PV/Grid hybrid energy system, which consists of 172 kW PV and the grid with NPC and COE of 1.65M, \$0.173/kWh. The system has a RF of 35.7%, which reduces CO₂ emissions, but the RF is low due to the grid price being cheap and low solar radiation. As the grid price becomes expensive, the RF increases. The battery is not being used since the grid provides power at night and due to economic consideration. The grid connected hybrid system is cost effective and emits less CO₂ when compared to the grid only system (299 and 461 tons of CO₂). The system creates more emissions than the standalone hybrid system due to low RF.

The second optimal system is PV/WT/grid design which has 169 kW PV panel, 2 kW wind turbine and the grid with NPC of \$1.66M and a COE of \$0.175/kWh. It has lower RF of 35.3% and it is cost effective when compared to the PV/on grid hybrid system. Hence, PV/On Grid is the most economical while the second system is slightly environmentally friendly.

Electricity production: The PV/grid connected hybrid system produces 759 MWh/year to meet 730 MWh/year load demand. The PV only produces 37.6% of the required energy while the other 62.4% is purchased from the Grid. The excess electricity is minimal because of the low RF of 35.7%. When the PV/Grid interactive and the PV/DG/Battery standalone HES is compared, the standalone system has high excess electricity due to high RF because the system has to be oversized to maintain the continuity of power supply as the grid is not available. The Figure 8 shows the PV/Grid interactive hybrid system's monthly average electricity distribution throughout the year.

Sensitivity analysis and global solar radiation and grid price: Sensitivity analysis is used to help examine the effects in variability of the renewable energy resources and grid price on NPC and COE. The values used for the grid price are \$0.15, \$0.16, \$0.18, \$0.19, \$0.20 and for solar radiation are 3.0, 4.26, 5.0, 6 kWh/m²/day with wind speed of 4.76 m/s. Figure 9 shows the effect of sensitivity analysis on COE for different grid price and solar insolation. From this Figure, the PV/Grid hybrid energy system is the most

Table 8. Economical comparison between the optimal configurations of hybrid system

Optimal system configuration	Net present cost (\$)	Operating cost (\$/yr)	Cost of energy (\$/kWh)	RF	CO ₂ emissions
PV/Diesel/Battery	4.28M	168,958	0.454	76.7	144 tons
PV/Wind/Diesel	4.29M	168,430	0.455	76.8	140 tons
PV/Grid	1.65M	90,960	0.173	35.7	299 tons
PV/Wind/Grid	1.70M	91,196	0.177	35.3	301 tons

economical system type for most sensitivity analysis considered except the green area. On the other hand, the Grid only system becomes the optimal system type for solar radiation between 3.0–4.20 kWh/m²/day and the grid price less than 0.18 \$/kWh. The results also show as the grid price increases, the NPC and COE increases but when solar radiation increases, the NPC and COE decreases while the RF increases.

Comparing the optimization results of the standalone and on grid hybrid system: Economical comparison between the optimal configurations of hybrid system is shown in Table 8.

From Table 8, the PV/Grid hybrid system is the most preferred one because it has low NPC and COE while the PV/WT/Diesel/Battery hybrid system is the least cost-effective system but environmentally friendly due to higher RF. The PV/Grid hybrid system has lower RF because the grid price of our case study is cheap and the area has low solar radiation, but as the grid price increases so do the RF and eventually leading to less CO₂ emissions.

CONCLUSIONS

Technical and economic evaluation of an off grid and standalone hybrid renewable energy system was studied using the HOMER pro program to perform simulation and come up with the most cost effective and environmentally friendly configuration for Eskişehir Technical University. The maximum load demand of the Department of Electrical and Electronics Engineering is 2MWh/day. HOMER optimization results presented the optimal configuration of PV/Diesel Gen/Battery, which can supply enough power to the load demand while the optimal configuration for the on-grid hybrid system was PV/Grid configuration. Out of the two systems, the PV/Grid hybrid system is the most economical hybrid system due to low NPC and COE (1.68M and 0.176 \$/kWh) when compared to the off-grid hybrid system (4.29M and 0.455\$/kWh). The PV/Grid hybrid system is more economical but not environmentally friendly due to low RF (35.4%) leading to high CO₂ emissions (302 tons) while the standalone hybrid system released less CO₂ emissions (110 tons) and has a quick payback period of 4.4 years compared to on grid system with 12 years of payback period.

Sensitivity analysis showed that as the global solar radiation increases, NPC and COE decreases, on the other hand as the cost of diesel and grid energy increase, NPC and COE also increase. So, in the future, as the cost of die-

sel and grid energy continue to increase hybrid renewable energy systems will become more attractive and cost effective, hence promoting the adaptation of renewable energy. To conclude, the technical and economic evaluation is vital to find optimal configuration of hybrid energy system.

To conclude, the PV/Grid hybrid system is the most economical but not environmentally friendly when compared to the standalone alone hybrid system. Therefore, the choice is with the customers whether in terms of cost or environmental benefits. In the future, hybrid renewable energy system will be the solution to energy problems since it combines both renewable and non-renewable energy sources [14].

After performing the technical and economic evaluation of both the standalone and grid connected hybrid system for the case study, the paper recommends both the standalone and grid connected hybrid system in Eskişehir region due to low NPC and COE for the grid connected system and low CO₂ emissions for the standalone hybrid system but mostly depends on whether your concern is financial or environmental pollution. Further studies can be realized on technical and economic evaluation of hybrid renewable energy systems using hydrogen production instead of batteries.

AUTHORSHIP CONTRIBUTIONS

Concept: H.K.A., Ü.B.F.; Design: H.K.A., Ü.B.F.; Supervision: H.K.A., Ü.B.F.; Data collection and/or processing: H.K.A., Ü.B.F.; Analysis and/or interpretation: H.K.A., Ü.B.F.; Literature search: H.K.A., Ü.B.F.; Writing: H.K.A., Ü.B.F.; Critical review: H.K.A., Ü.B.F.

DATA AVAILABILITY STATEMENT

The published publication includes all graphics and data collected or developed during the study.

CONFLICT OF INTEREST

The author declared no potential conflicts of interest with respect to the research, authorship, and/or publication of this article.

ETHICS

There are no ethical issues with the publication of this manuscript.

REFERENCES

- [1] Usman, M., Khan M. T., and A. S. Rana., Techno-economic analysis of hybrid solar-diesel-grid connected power generation system, *Journal of Electrical Systems and Information Technology* 2018, vol. 5, pp. 653-662.
- [2] Başaran Filik, Ü., Filik, T. and Gerek, Ö.N. A hysteresis model for fixed and sun tracking solar PV power generation systems. *Energies* 2018, 11, 603.
- [3] E. K. M. T. G. & M. O. Abdulsamed Tabak, "Grey wolf optimization for optimum sizing and controlling of a PV/WT/BM hybrid energy system considering TNPC, LPSP, and LCOE concepts," *Energy Sources, Part A: Recovery, Utilization, and Environmental Effects*, pp. 1-22, 2019.
- [4] A. F. F. K. B. M. T. A N. C. Yahiaoui, "Grey wolf optimizer for optimal design of hybrid renewable energy system PV-diesel generator-battery: Application to the case of Djanet city of Algeria.," *Solar Energy*, 2017.
- [5] Asrari A., Ghasemi A., and Javidi M. H., Economic evaluation of hybrid renewable energy systems for rural electrification in Iran-A case study, *Renewable and Sustainable Energy Reviews* 2012, vol. 16, pp. 3123-3130.
- [6] Kolhe M., Ranaweera K. I. U., and Gunawardana A. S., Techno-Economic Optimum Sizing of Hybrid Renewable Energy System., *Rural Electrification in Sri Lanka* 2013.
- [7] Baneshi M., and Hadianfard F., Techno-economic feasibility of hybrid diesel/PV/wind/battery electricity generation systems for non-residential large electricity consumers under southern Iran climate conditions, *Energy Conversion and Management* 2016, vol. 127, pp. 233-244.
- [8] Rezzouk H., and Mellit A., Feasibility study and sensitivity analysis of a stand-alone photovoltaic-diesel-battery hybrid energy system in the north of Algeria, *Renewable and Sustainable Energy Reviews* 2015, vol. 43, pp. 1134-1150.
- [9] Abed K., Moawad M., Refaey H., and Salem S., Techno - Economic Study of Hybrid Renewable Energy System for Remote Area in Sinai, *Journal of Scientific and Engineering Research* 2017, vol. 4, no. 2394-2630, pp. 366-376.
- [10] Oueslati H., and Mabrouk S. B., Techno-economic analysis of an on-grid PV/Wind/Battery hybrid power system used for electrifying building, *Energy Sources, Part A: Recovery, Utilization, and Environmental Effects* 2019, no. 1556-7036.
- [11] Ghasemi A., Asrari A., Zarif M., Abdelwahed S., Techno-economic analysis of stand-alone hybrid photovoltaic-diesel-battery systems for rural electrification in eastern part of Iran—A step toward sustainable rural development, *Renewable and Sustainable Energy* 2013, cilt 28, pp. 456-462.
- [12] Khalid F., El-Emam R. S., Hogerwaard J., Dincer I., Techno-economic Feasibility of Renewable Energy Based Stand-alone Energy System for a Green House: Case Study, *Future Cities and Environment* 2018, cilt 12, pp. 1-9.
- [13] Mondal K. G. M. A. H., Ringler C., Gebremeskel A. G., Optimization and cost-benefit assessment of hybrid power systems for off-grid rural electrification in Ethiopia, *Energy* 2019, cilt 177, pp. 234-246.
- [14] Teoh W. Y., Khu, S. Y., Tan C. W., Hii I. H and K. W. Cheu, Technoeconomic and Carbon Emission Analysis for a Grid-Connected Photovoltaic System in Malacca, *International Scholarly Research Notices* 2012, no. 745020, p. 8.
- [15] Nand R. T., Design and techno-economic analysis of a grid-connected photovoltaic power system at Fiji National University Samabula Campus 2010.
- [16] Wang J. Lu, W., Zhang Y., Ye S., Techno-Economic Feasibility of PV-wind-diesel-battery Hybrid Energy System in a Remote Island in the South China Sea, *AMSE JOURNALS-AMSE IIETA publication* 2017, cilt 90, pp. 162-182.
- [17] Anene, C., Olatomiwa, L and Akinyele, D. Technical and Economic Evaluation of Standalone Hybrid Renewable Power System for a Remote Location in Nigeria. 2nd International Engineering Conference (IEC 2017), minna, Nigeria, 2017.
- [18] Abolfazl G., Arash A., Mahdi Z. and Sherif A., Techno-economic analysis of stand-alone hybrid photovoltaic-diesel-battery systems for rural electrification in eastern part of Iran—A step toward sustainable rural development, *Renewable and Sustainable Energy Reviews* 2013.